



Property Line



 UPC Transformer or Secondary Pedestal

Legend

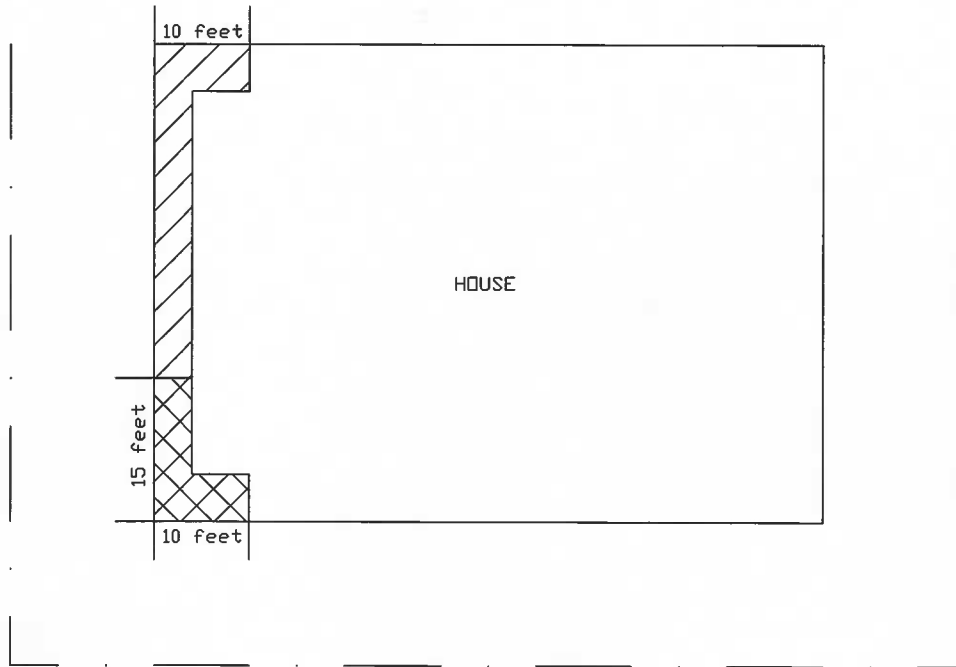

UPC acceptable meter base location if house is 10 feet or less from property line



UPC acceptable meter base location if house is greater than 10 feet from property line

Guidelines

Center of meter base shall be between four and six feet above final grade.

Meter base shall be installed on an exterior wall and shall not be enclosed.

Non-standard location of meter base will be subject to additional footage charge.



Union Power Cooperative

Meter Base Location Specification

SCALE 1" = 20'

SHEET 1 of 1

5/10/12 MSB